


**INSTALLATION SPECIFICATIONS
FOR
DOUBLE CHECK VALVE ASSEMBLIES
DCVA'S**




All DCVA (Double Check Valve Assemblies) backflow protection devices shall be located in an above ground insulated enclosure or in ground pit/box within 15 feet of the meter box, meter vault, or property line when not otherwise prohibited by conflict or barriers which make construction or access for maintenance unreasonable.

All above ground enclosures must be insulated with a drain at one end.

Above Ground Installation:

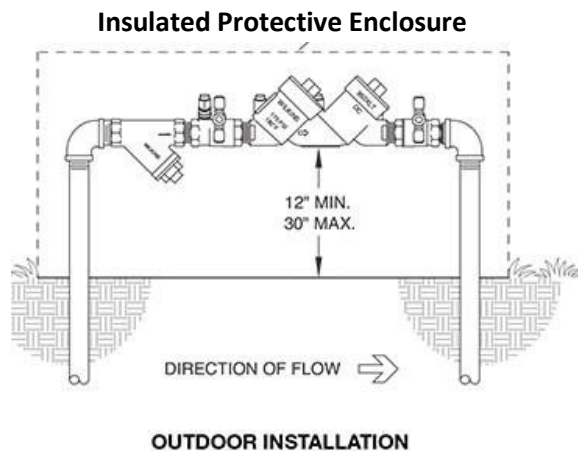

In Ground Installation:

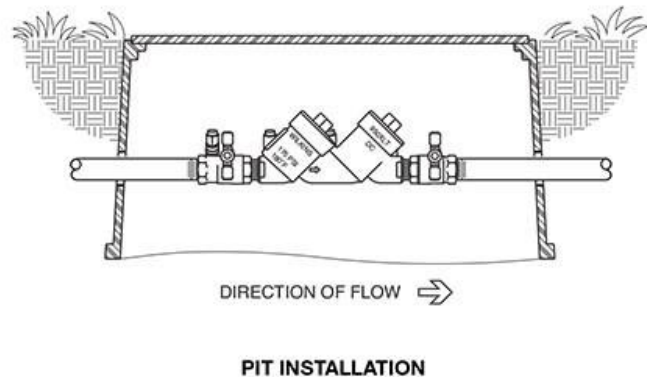

**TYPICAL INSTALLATION WITH MINIMUM CLEARANCES
DOUBLE CHECK VALVE ASSEMBLY (DCVA)**